



PHOTOVOLTAIC REQUIREMENTS

NOTE: This label are for DC photovoltaic source circuits only. Labels are required every 10' and on every section separated by an enclosure, wall, partition, ceiling or floor.


NOTE: Center to center distance between main service meter and A/C disconnect shall be 60" maximum

PHOTOVOLTAIC POWER SOURCE
 RATED MAX POWER-POINT CURRENT _____ AMP
 RATED MAX POWER-POINT VOLTAGE _____ VOLTS
 MAXIMUM SYSTEM VOLTAGE _____ VOLTS
 MAXIMUM CIRCUIT CURRENT _____ AMPS

WARNING: PHOTOVOLTAIC POWER SOURCE

PHOTOVOLTAIC SYSTEM EQUIPPED WITH RAPID SHUTDOWN

WARNING
 ELECTRICAL SHOCK HAZARD. DO NOT TOUCH TERMINALS. TERMINALS ON BOTH THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION


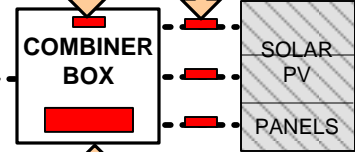


WARNING
 ELECTRIC SHOCK HAZARD THE DC CONDUCTORS OF THIS PHOTOVOLTAIC SYSTEM ARE UNGROUNDED AND MAY BE ENERGIZED


NOTE: This label is for Ungrounded PV systems only.

WARNING
 ELECTRIC SHOCK HAZARD. IF GROUND FAULT IS INDICATED NORMALLY GROUNDED CONDUCTORS MAY BE UNGROUNDED AND ENERGIZED

NOTE: This label is to be located near the ground-fault indicator.

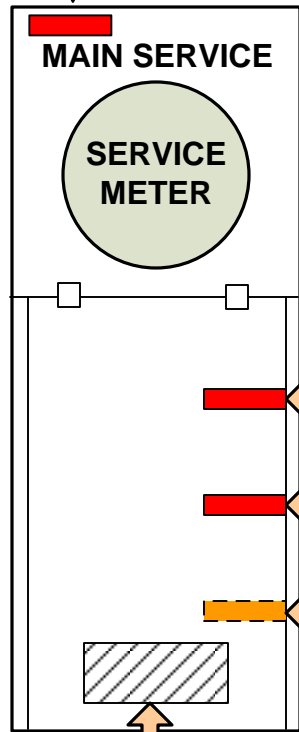

PHOTOVOLTAIC DISCONNECT FOR UTILITY OPERATIONS

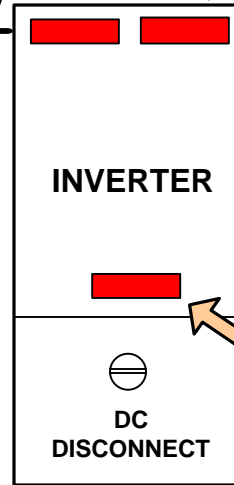

WARNING
 THIS SERVICE METER IS ALSO SERVED BY A PHOTOVOLTAIC SYSTEM

PV POWER MAX AC OUTPUT
 NOMINAL OPERATING AC VOLTAGE _____ VOLTS
 RATED AC OUTPUT CURRENT _____ AMPS

WARNING
 INVERTER OUTPUT CONNECTION. DO NOT RELOCATE THIS OVERCURRENT DEVICE

This label is to be located adjacent to the PV breaker.

A PERMANENT PLAQUE OR DIRECTORY, DENOTING ALL ELECTRIC POWER SOURCES ON OF IN THE PREMISES, SHALL BE INSTALLED AT EACH SERVICE EQUIPMENT LOCATION AND AT LOCATIONS OF ALL ELECTRIC POWER PRODUCTION SOURCES. See reverse side for sample directory.

Signage or labeling specifications:

- A. Reflective
- B. Red background with white lettering
- C. 3/8" letter height
- D. All capital letters
- E. Arial or similar font
- F. Weather resistant material (i.e. engraved plastic)

CAUTION

POWER TO THIS BUILDING IS ALSO SUPPLIED FROM THE FOLLOWING SOURCES WITH DISCONNECTS LOCATED AS SHOWN.

